

**SEWER CONSTRUCTION
NOISE VARIANCE FOR NIGHT WORK REVISIONS**

*Please see below and attached pertaining to the
City & County of Honolulu, Department of Environmental Services'*

**Awa Street Wastewater Pump Station
Force Main and Sewer System Improvements
Waiakamilo Road Trunk Sewer Project**


<p>The purpose of this meeting is to update the community on the revisions to the noise variance permit (No. 16-NR-VN-39) for this project.</p>	
<p>Date & Time:</p>	<p>September 10, 2019 (Tuesday) 6:00 pm - 7:00 pm</p>
<p>Address:</p>	<p>Farrington High School - Cafeteria 1564 North King Street (Cafeteria located on Ewa side of campus, closer to Kalihi Street.)</p>

*For more information please call the project hotline at (808) 219-7009,
or visit the official website at www.awasewer.org – Mahalo!*


54" PIPE
INSTALLATION
BY OPEN
EXCAVATION

54" PIPE INSTALLATION BY MICROTUNNELING

42" PIPE INSTALLATION BY MICROTUNNELING

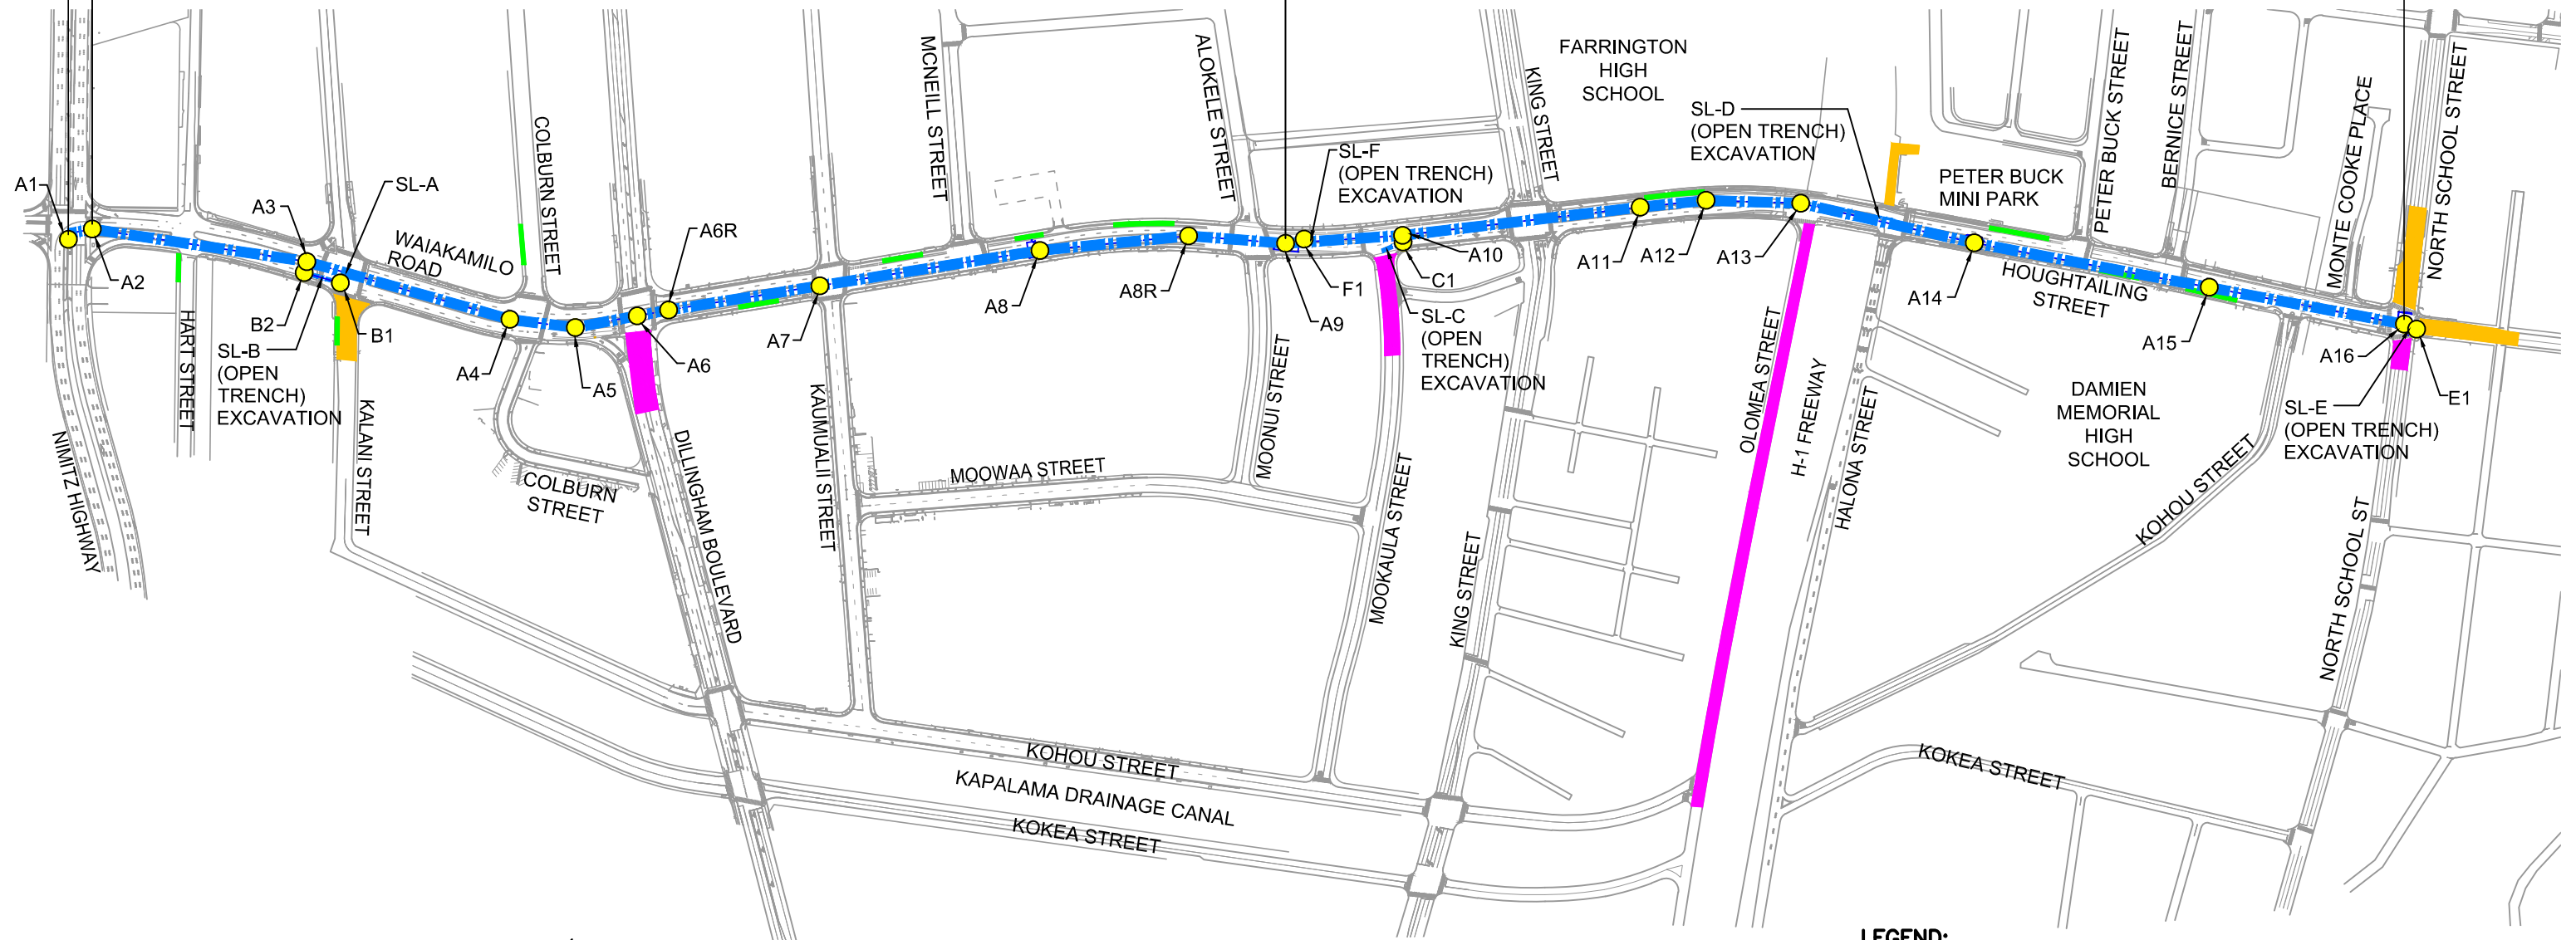

- LEGEND:**
- NEW SEWER MANHOLE
 - NEW SEWER LINE
 - ABANDONED SEWER MANHOLE AND SEWER LINE WORK AREA
 - TEMPORARY EQUIPMENT STORAGE AREA
 - TEMPORARY BYPASS WORK AREA



CITY AND COUNTY OF HONOLULU
DEPARTMENT OF ENVIRONMENTAL SERVICES

**AWA STREET WASTEWATER PUMP STATION
FORCE MAIN AND SEWER SYSTEM IMPROVEMENTS
WAIAKAMILO ROAD TRUNK SEWER, C&C JOB NO. W5-16**